


COMMERCIAL UNIT 1

SPACE SUITABLE FOR A RESTAURANT
WITH COMMERCIAL KITCHEN

POSSIBILITY TO VENT KITCHEN HOOD
THROUGH BACK WALL ONTO THE
LOWER ROOF

POSSIBLE HRV
LOCATION

POSSIBLE KITCHEN
HOOD LOCATION

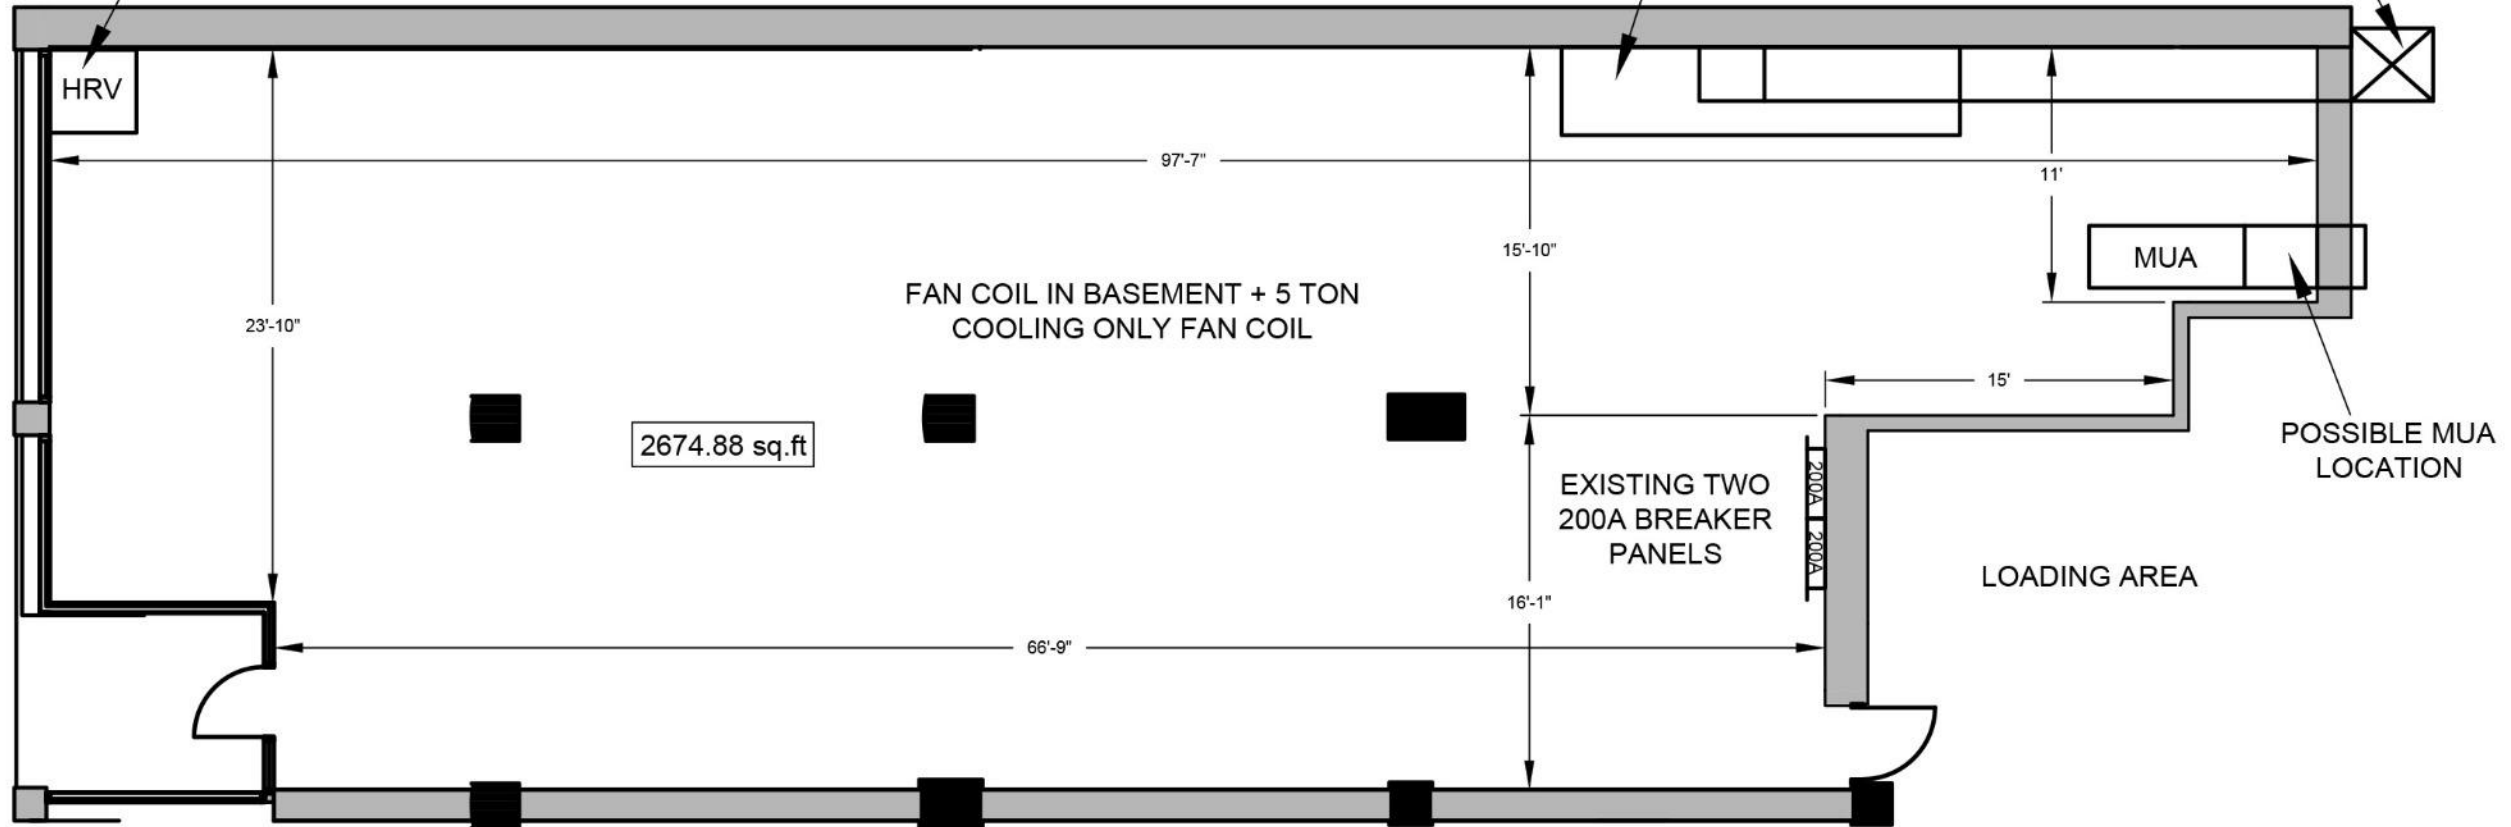

NOTES:

1. POSSIBILITY OF 600V ELECTRICAL SERVICE.
2. HEATING PROVIDED BY BUILDING PLANT VIA HEATING WATER.
FAN COILS LOCATED IN THE BASEMENT.
3. COOLING PROVIDED BY BUILDING PLANT VIA CHILLED WATER.
FAN COILS LOCATED IN THE BASEMENT.