


## COMMERCIAL UNIT 2

SPACE SUITABLE FOR A RESTAURANT  
WITH A COMMERCIAL KITCHEN

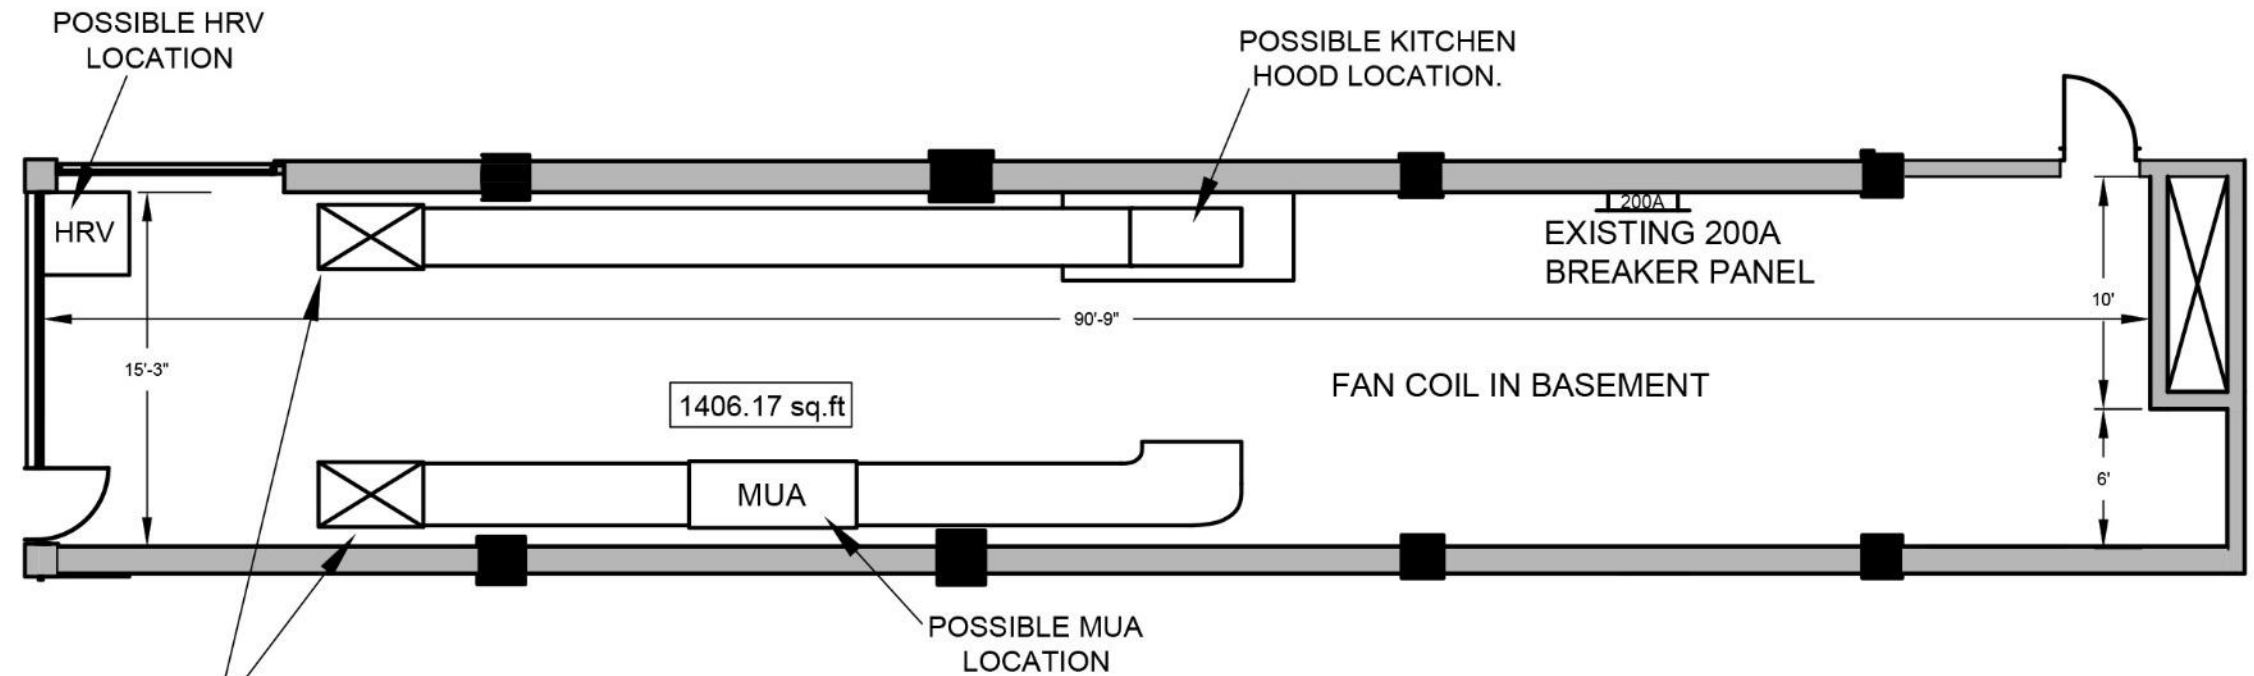

POSSIBILITY TO VENT KITCHEN HOOD AND MUA INTAKE  
WITH CEILING PENETRATION THROUGH THE SECOND  
FLOOR ONTO THE THIRD FLOOR FRONT ROOF.

### NOTES:

1. POSSIBILITY OF 600V ELECTRICAL SERVICE.
2. HEATING PROVIDED BY BUILDING PLANT VIA HEATING WATER.  
FAN COILS LOCATED IN THE BASEMENT.
3. COOLING PROVIDED BY BUILDING PLANT VIA CHILLED WATER.  
FAN COILS LOCATED IN THE BASEMENT.