


COMMERCIAL UNIT 3

SPACE SUITABLE FOR A RESTAURANT
WITH A COMMERCIAL KITCHEN

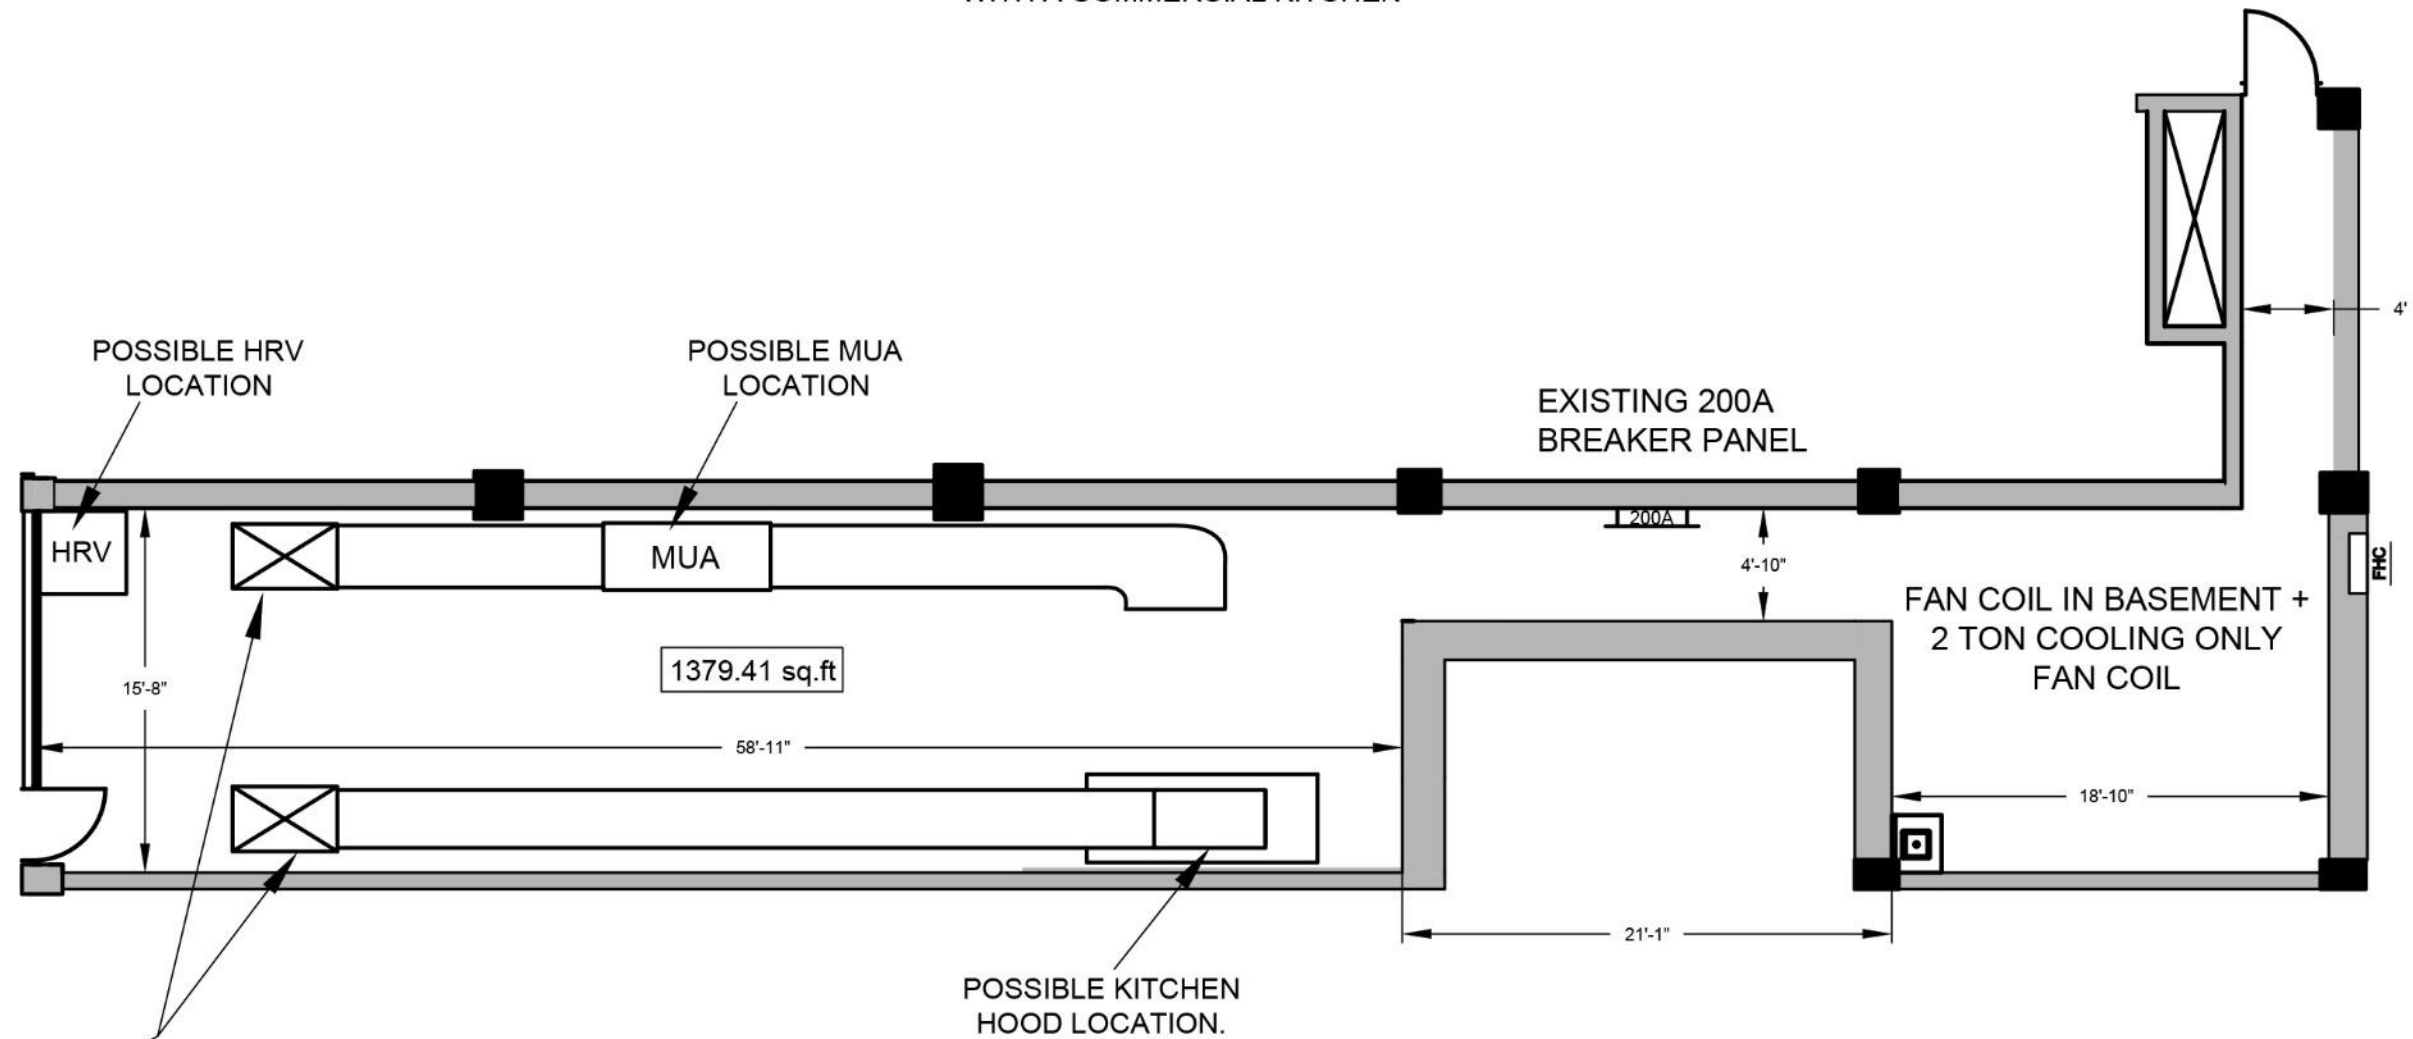

NOTES:

1. POSSIBILITY OF 600V ELECTRICAL SERVICE.
2. HEATING PROVIDED BY BUILDING PLANT VIA HEATING WATER. FAN COILS LOCATED IN THE BASEMENT.
3. COOLING PROVIDED BY BUILDING PLANT VIA CHILLED WATER. FAN COILS LOCATED IN THE BASEMENT.